


## Digging Up To a Stobie pole (but not past)

Excavations can occur up to 350mm wide and up to 600mm deep when digging up to a Stobie pole. If digging past a Stobie pole, please refer to the 'Digging Past a Stobie Pole' section.

Excavations up to Stobie pole that are wider than 350mm or deeper than 600mm fall within the exclusion zone and require written authority from SA Power Networks through the 'Request for network access' page on SA Power Networks' website.

**Note – this information is not relevant for digging past a Stobie pole.**


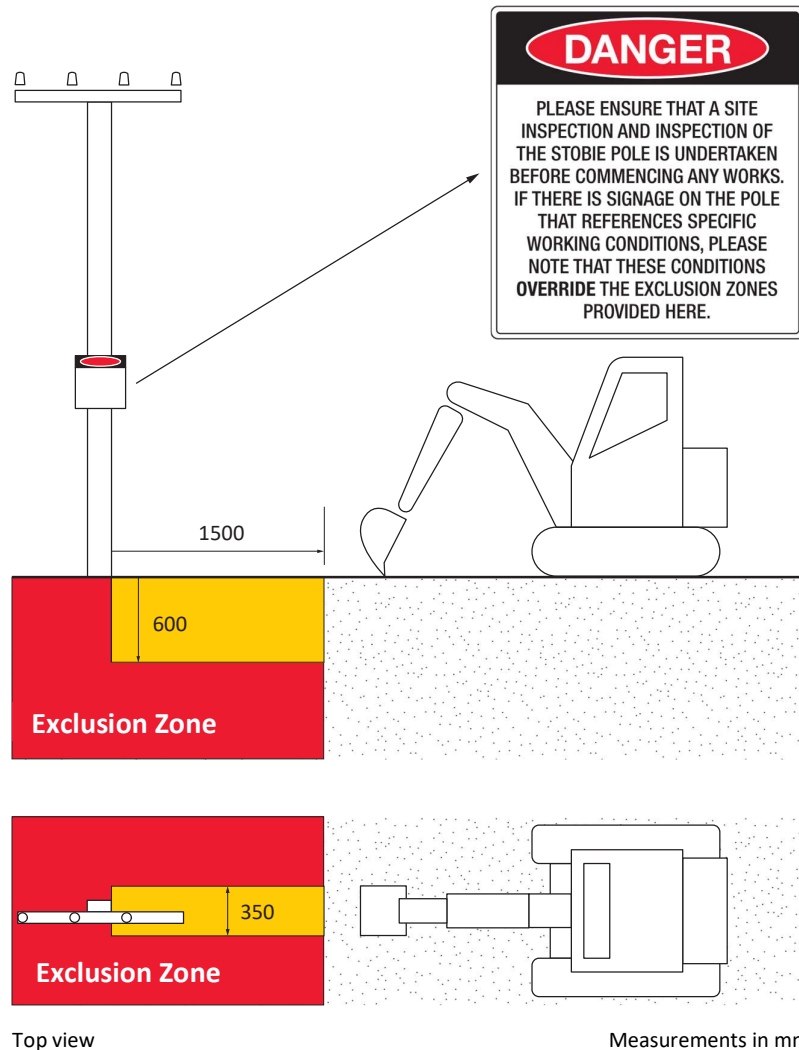


Due to the schematic nature of this user guide, the positions and equipment shown are indicative only and shall be verified on site

## Digging **Past** a Stobie pole

Excavations up to a depth of 300mm are permitted when excavating past or around SA Power Networks' Stobie poles. Excavation is **NOT** permitted deeper than 300mm within a distance of 1,500mm of the pole, without SA Power Networks' written authority, unless digging up to a Stobie pole (refer *Digging up to a Stobie Pole*). For a distance between 1,500mm and 3,000mm no excavation is permitted deeper than 600mm without SA Power Networks' written authority. For excavations further than 3,000mm from a Stobie pole there are no restrictions. These requirements as shown in the figure below. Enquiries are required for all works that fall into the exclusion zone. For excavations that fall within the exclusion zones please contact SA Power Networks through the 'Request for network access' page on SA Power Networks' website.

**Note – this information is not relevant for digging up to a Stobie pole.**

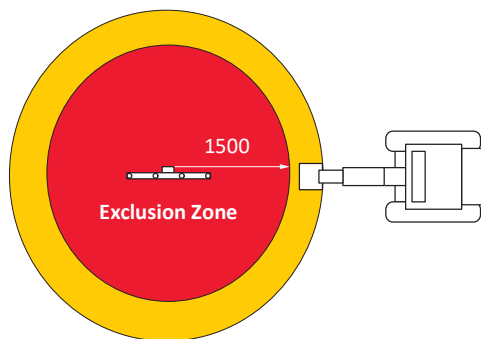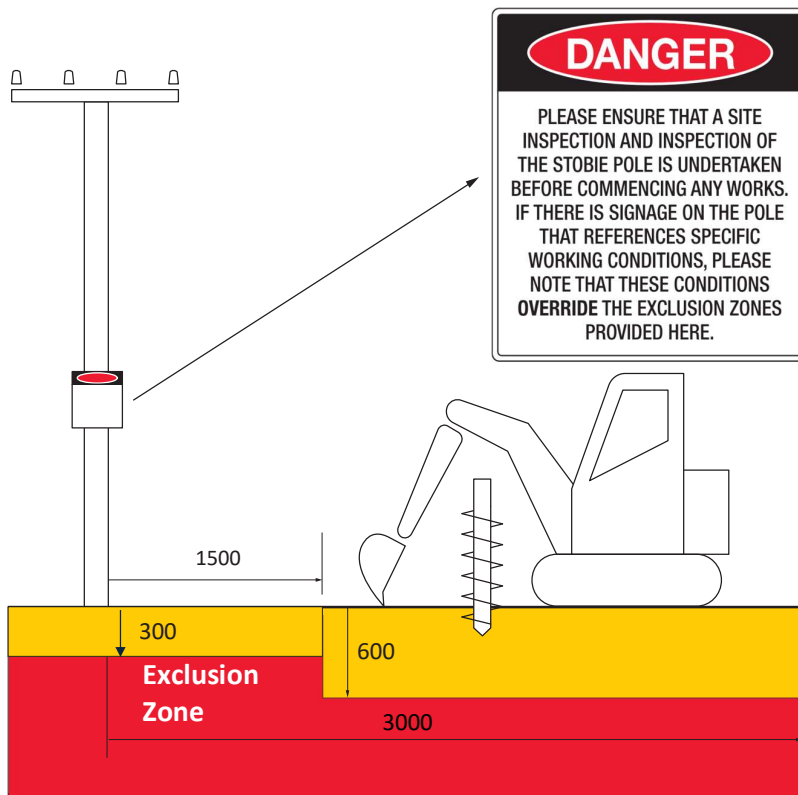

Top view  
For excavations deeper  
than 300mm

Measurements in mm

Due to the schematic nature of this user guide, the positions and equipment shown are indicative only and shall be verified on site